



FIG. 1

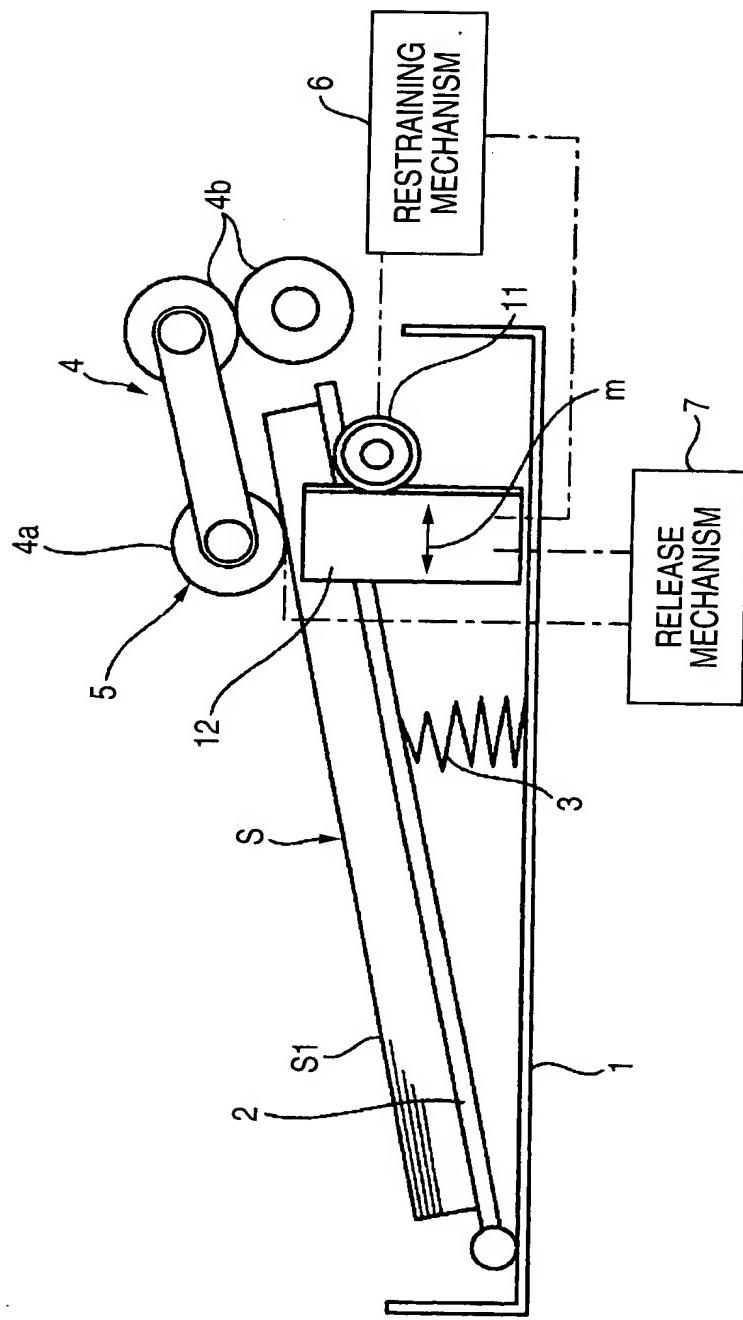




FIG. 2


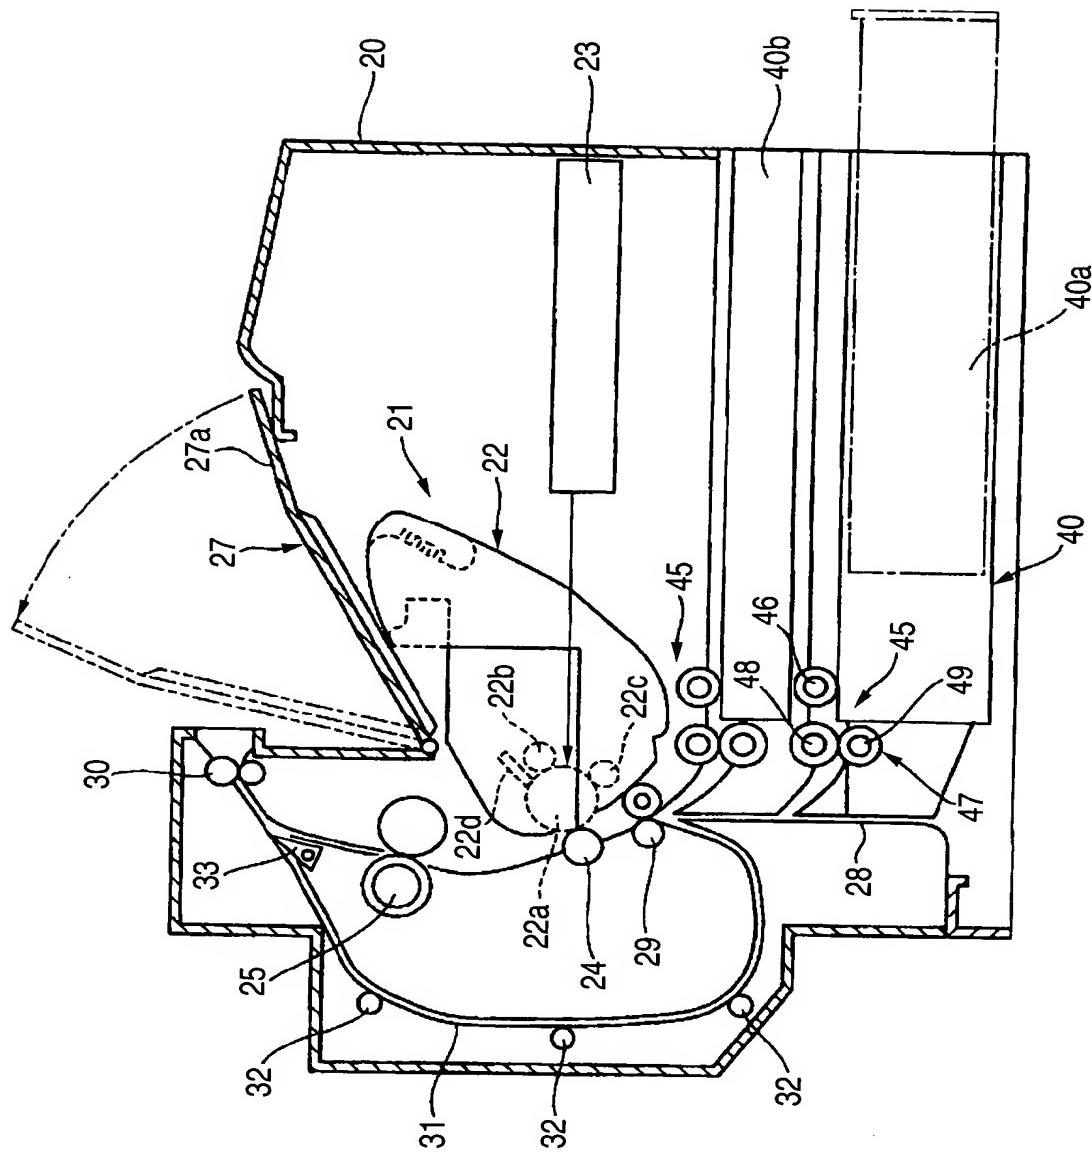




FIG. 3



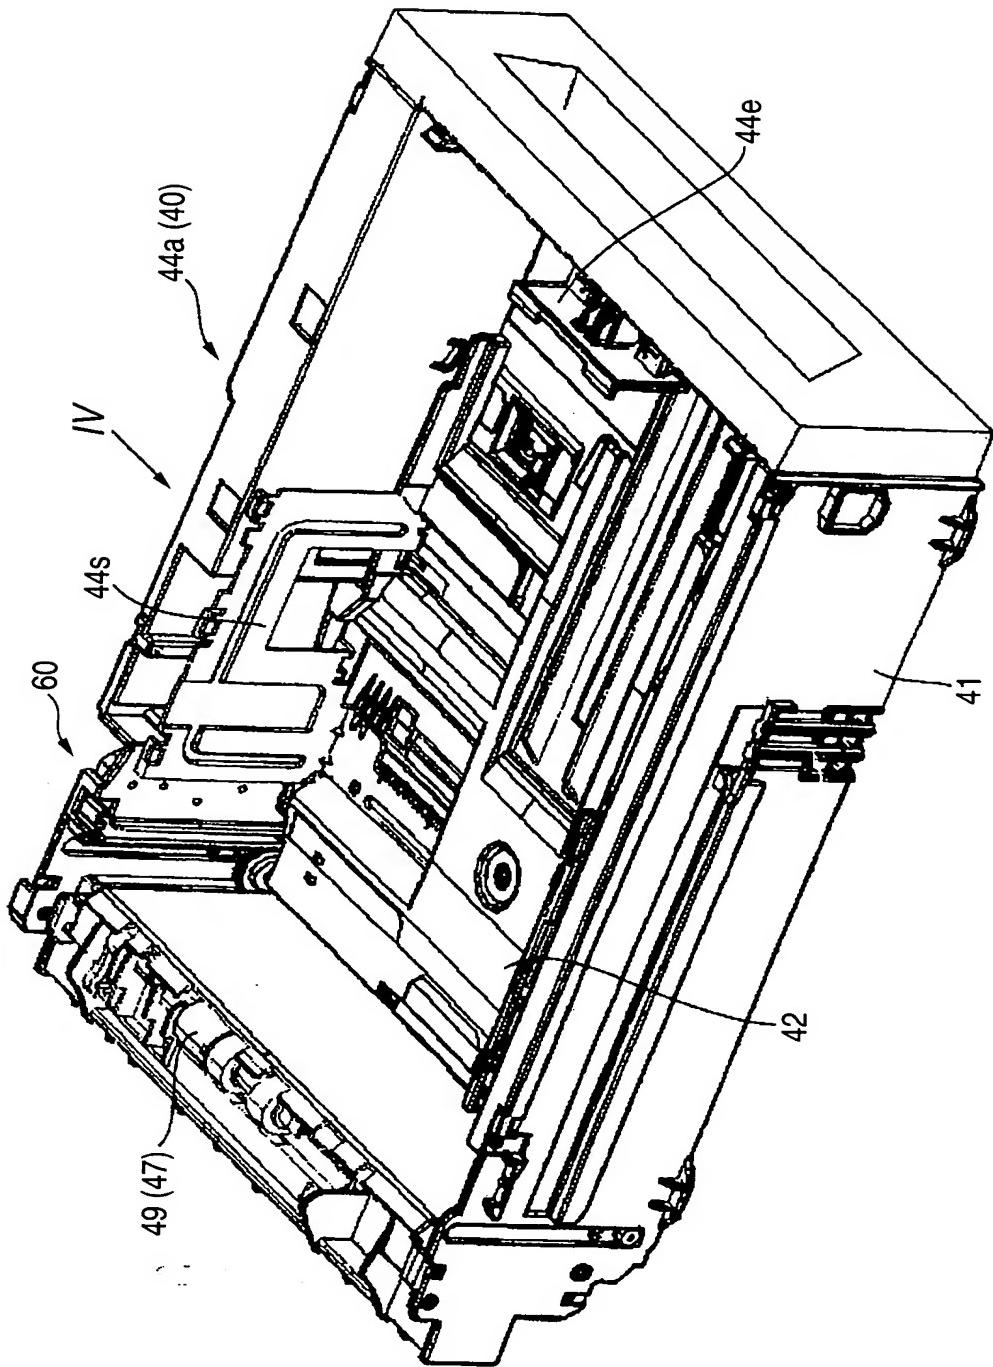

**REPLACEMENT  
SHEET**

4/31

FIG. 4

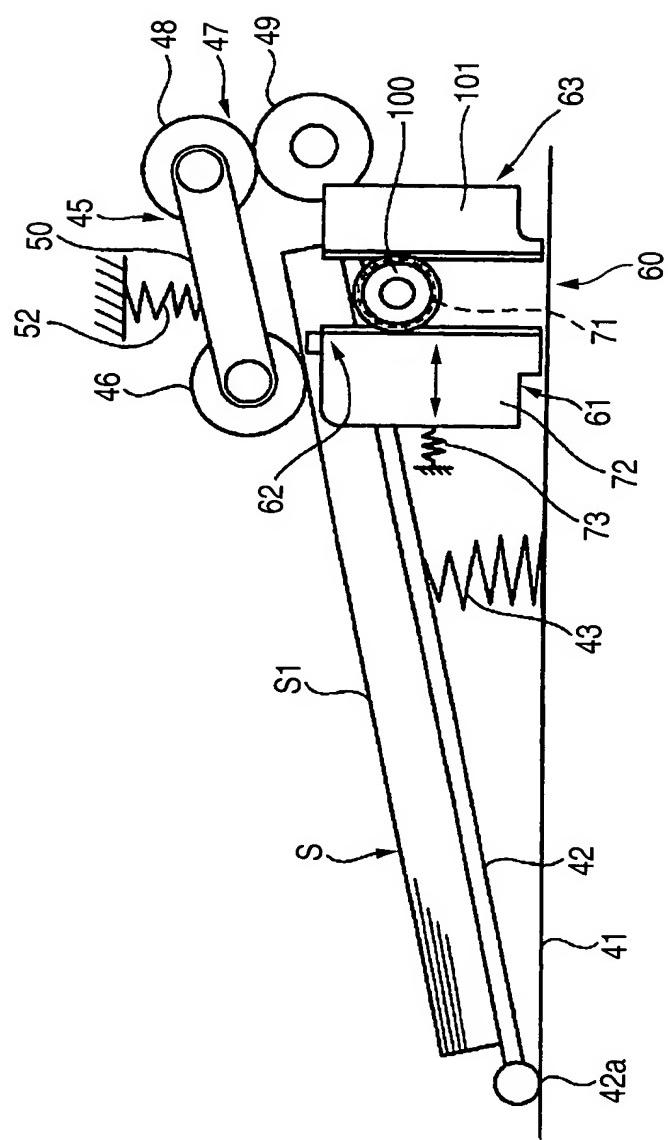




FIG. 5

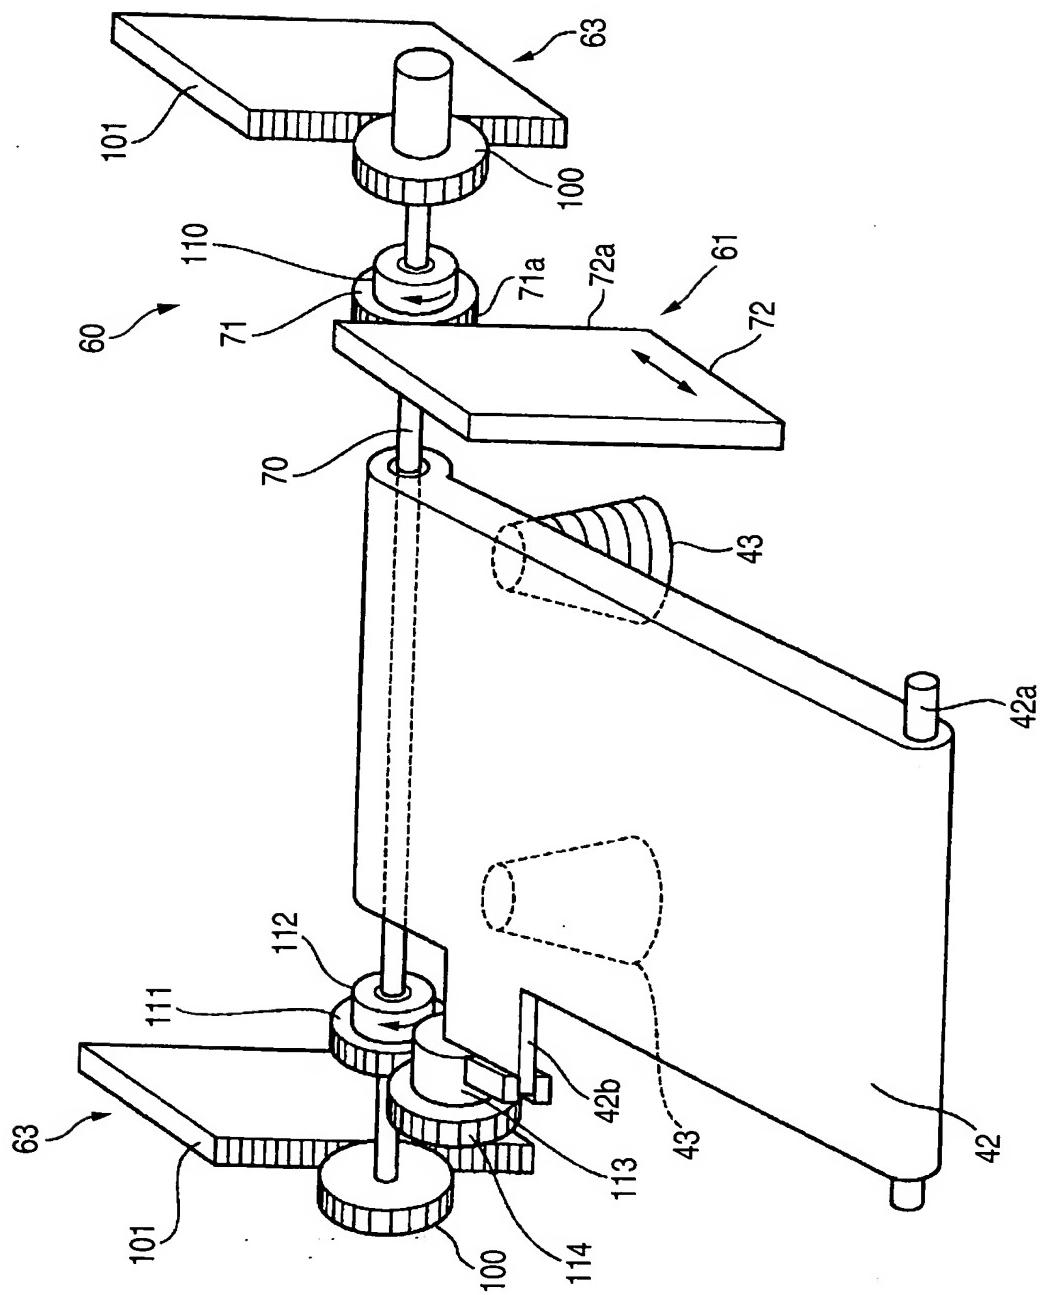




FIG. 6

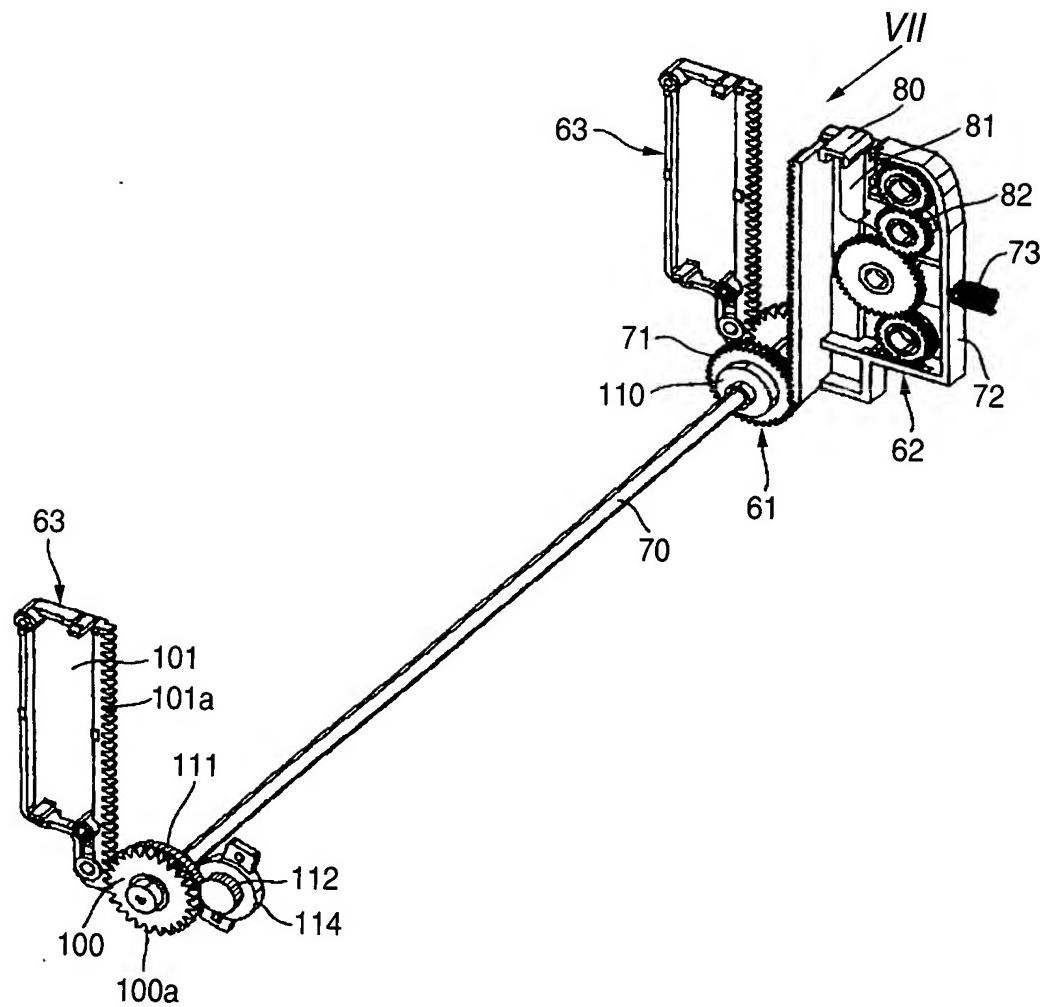




FIG. 7

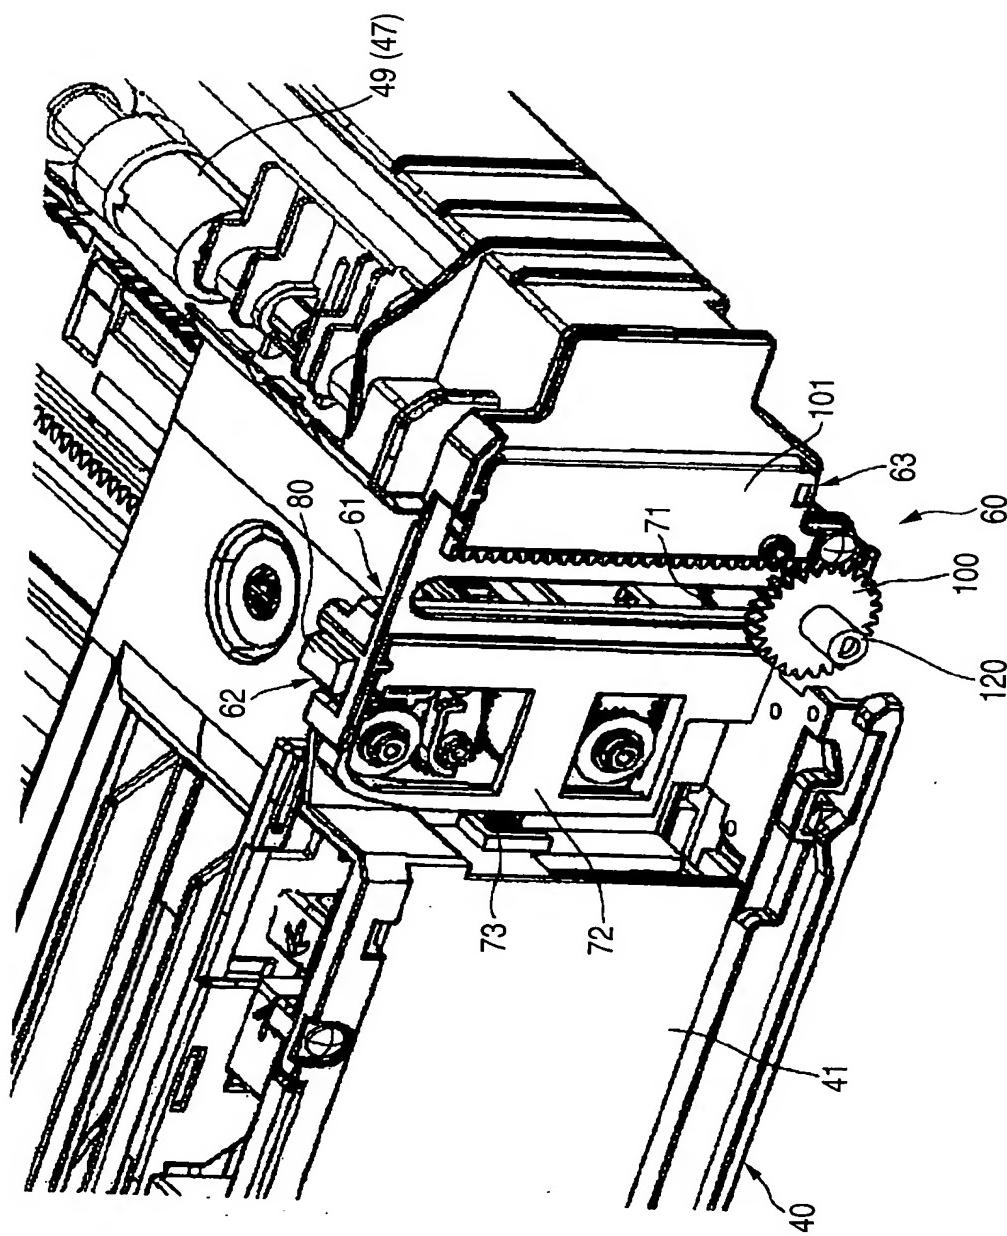




FIG. 8 (a)


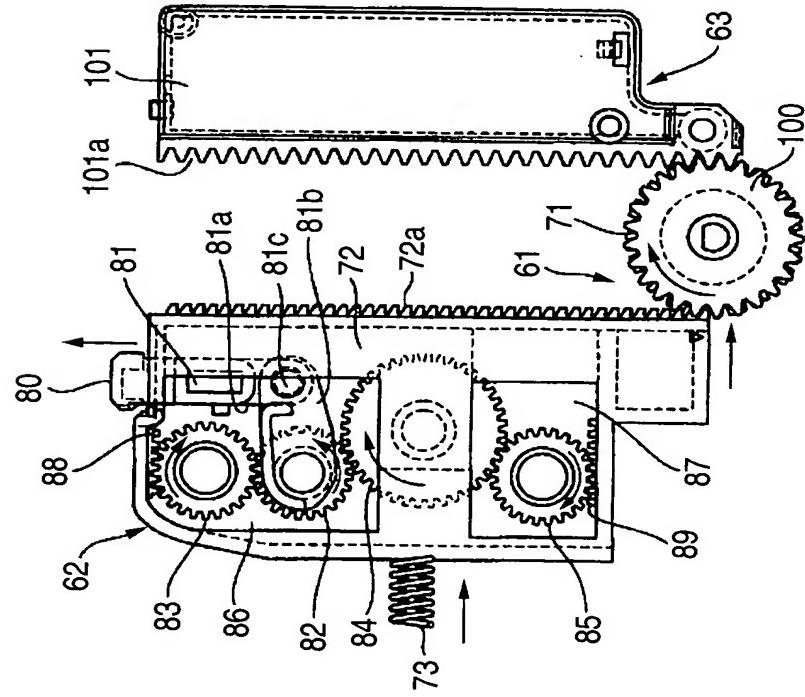


FIG. 8 (b)



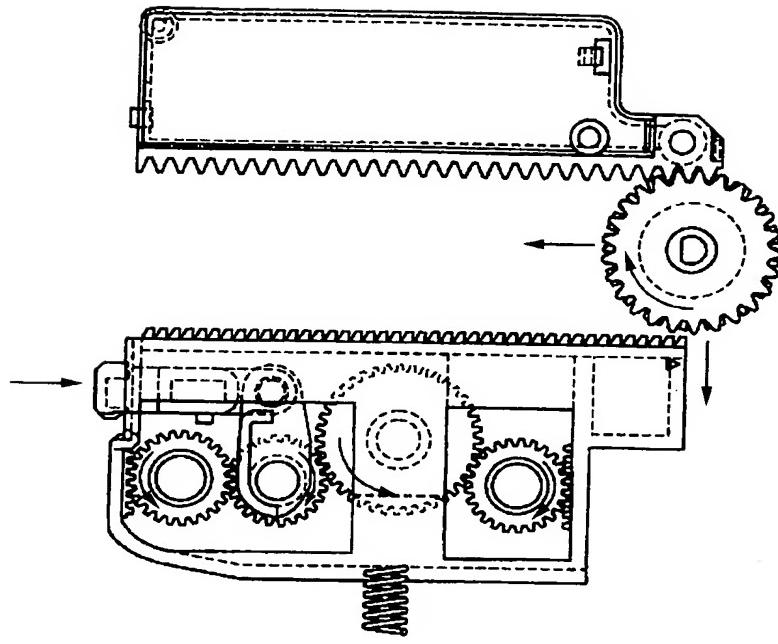

9/31

FIG. 9

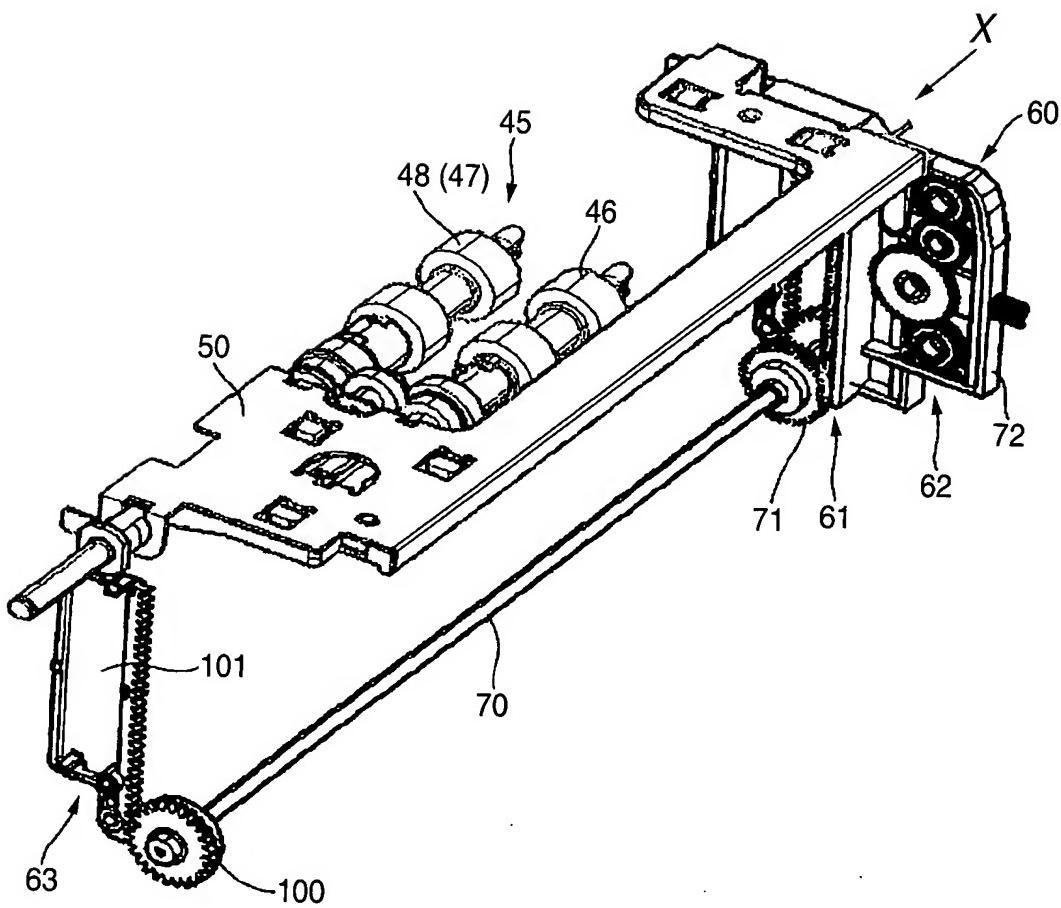
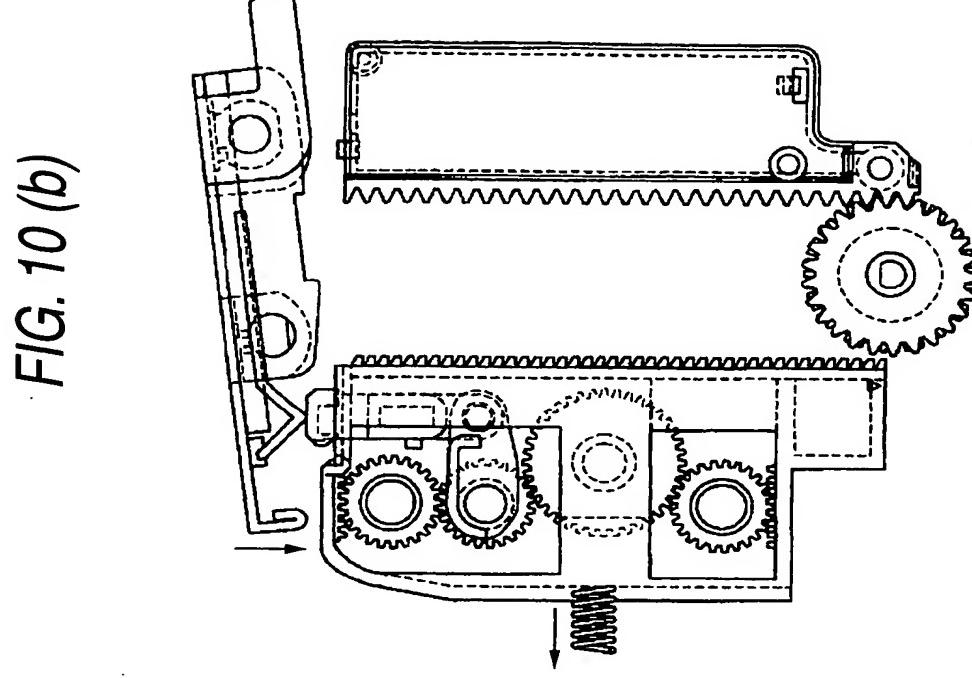
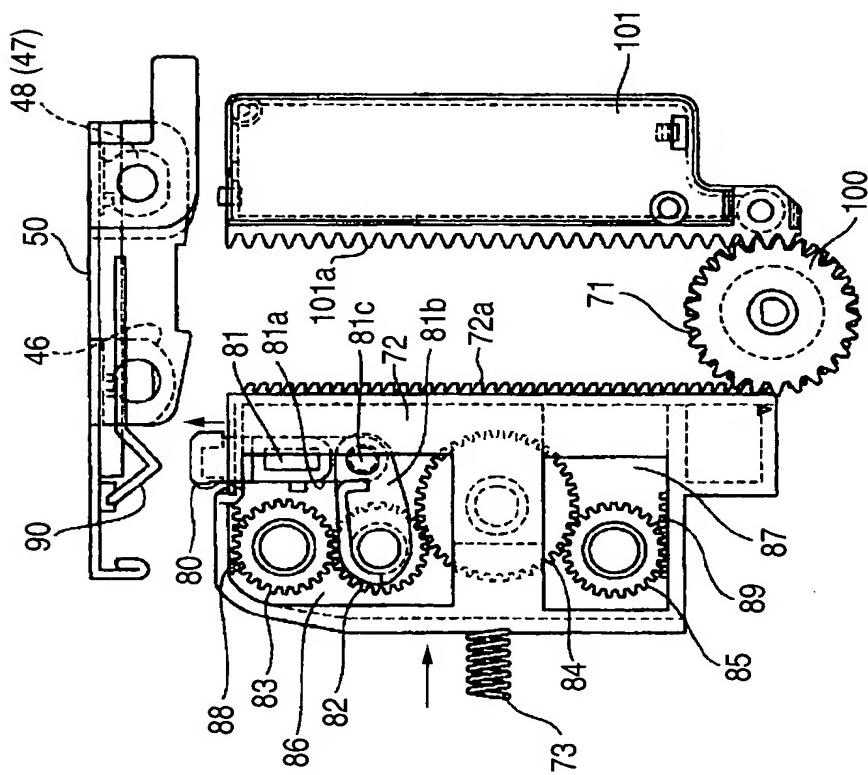




FIG. 10 (a)







FIG. 11

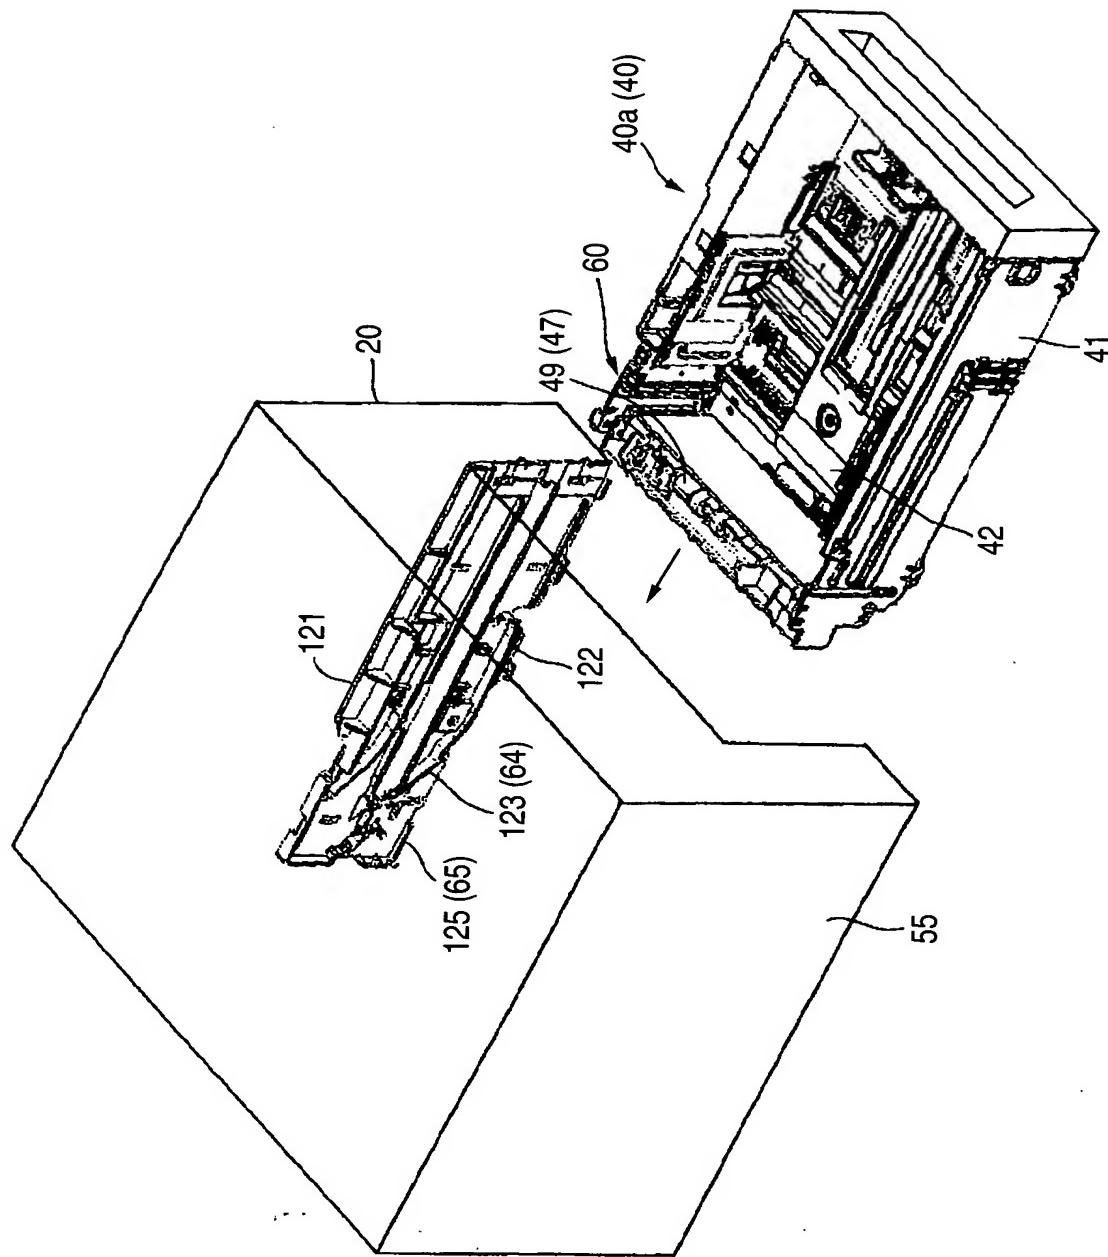

12/31



FIG. 12


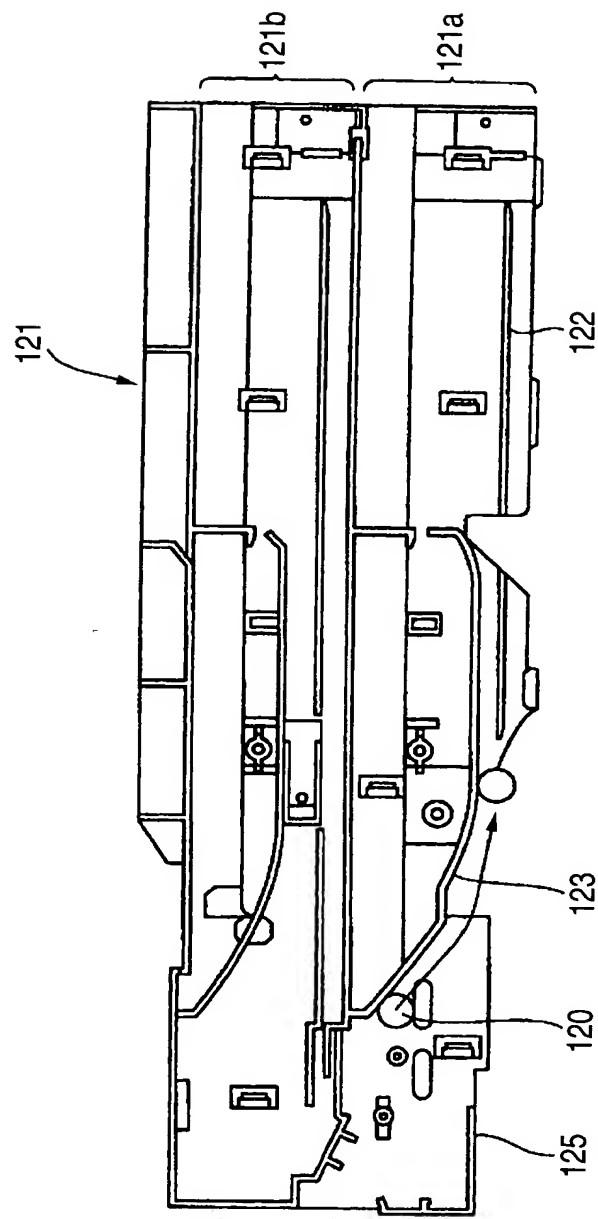




FIG. 13

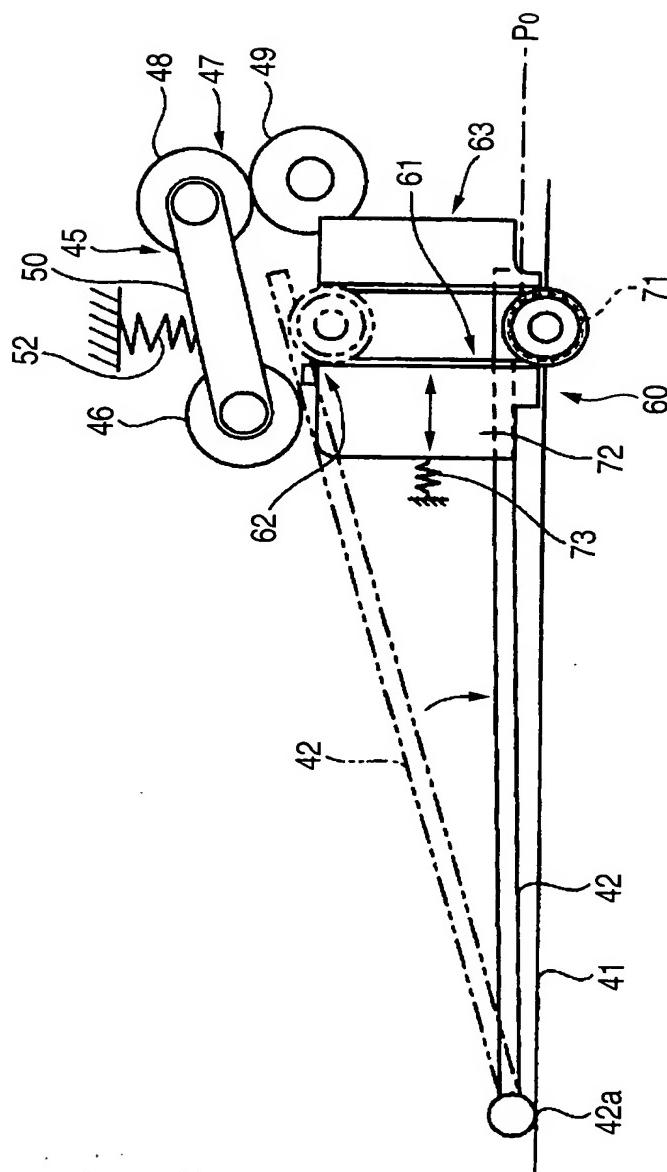

REPLACEMENT  
SHEET

14/31



FIG. 14

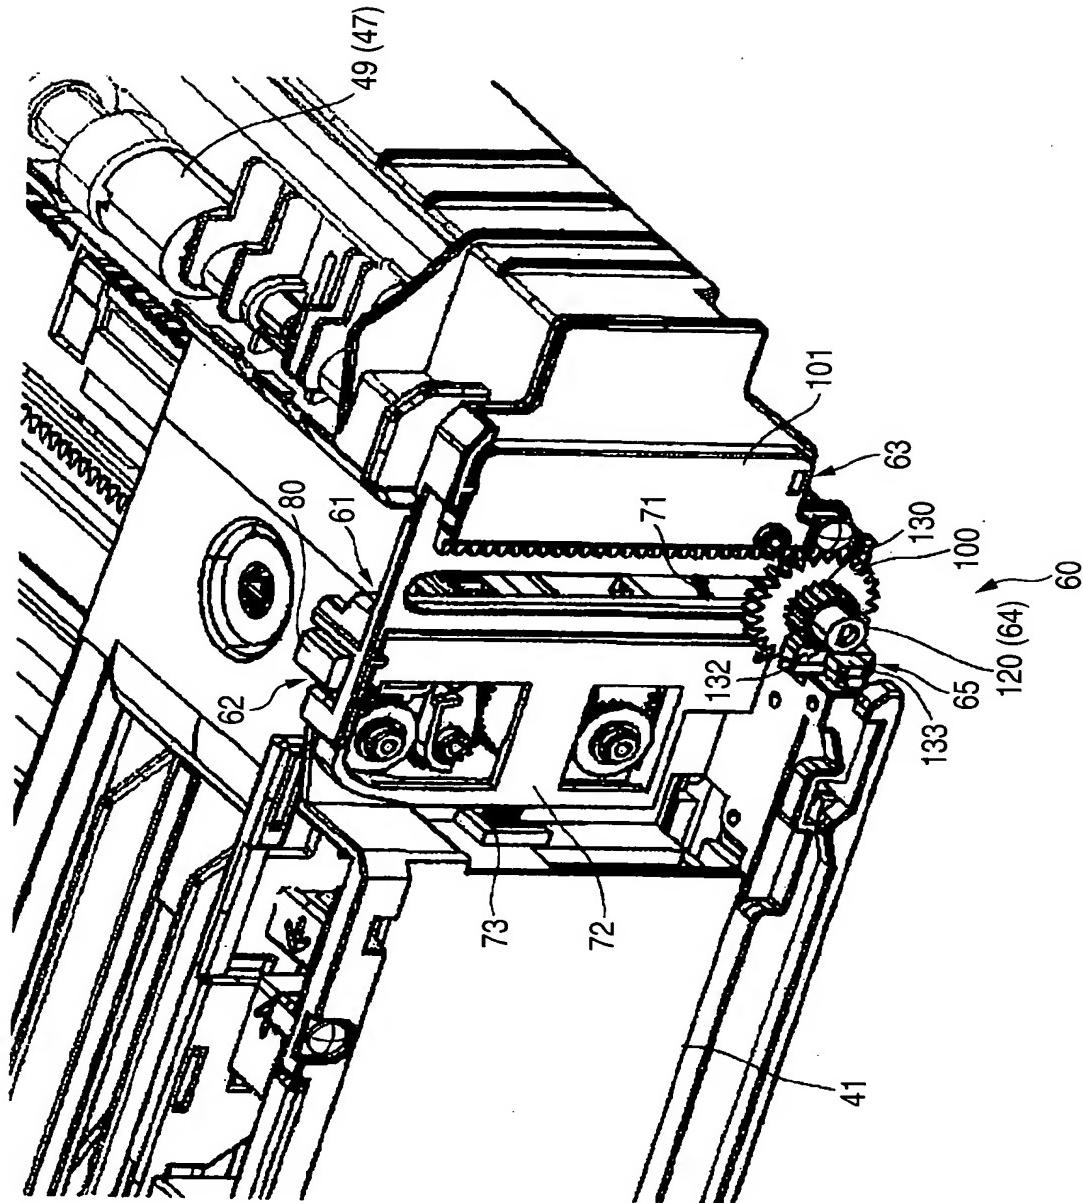




FIG. 15

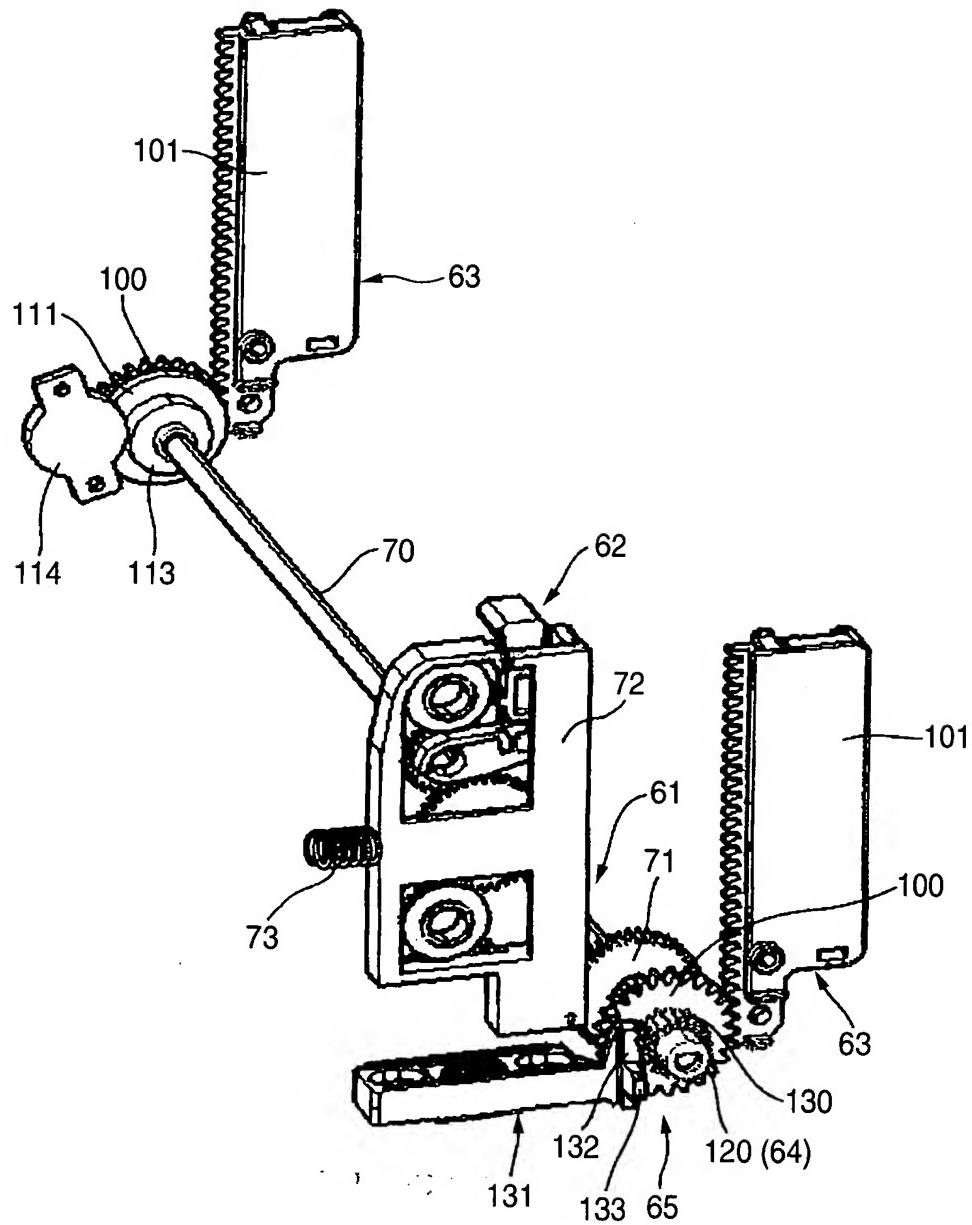


FIG. 16

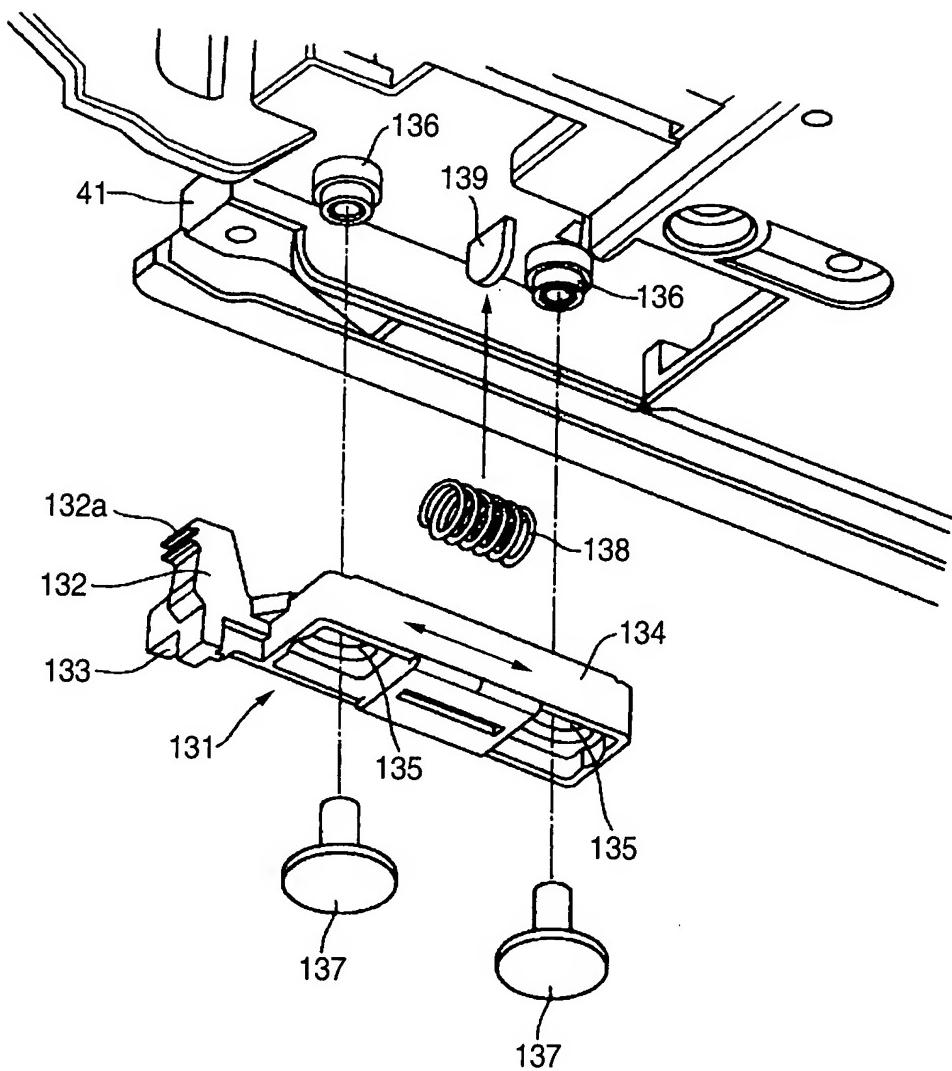


FIG. 17


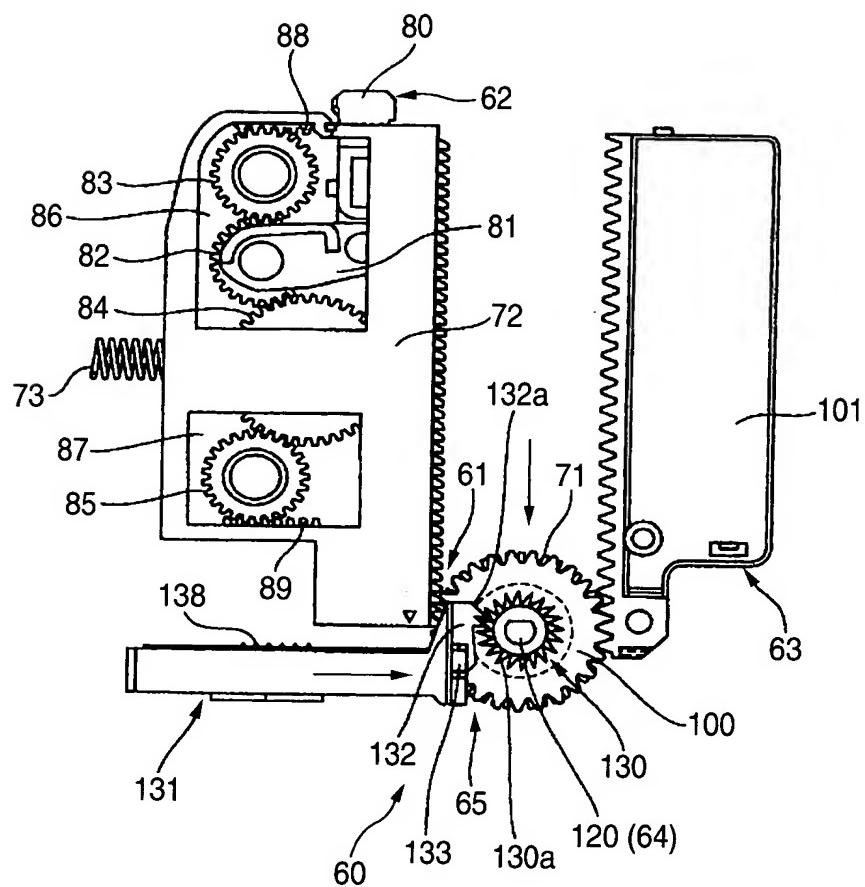


FIG. 18



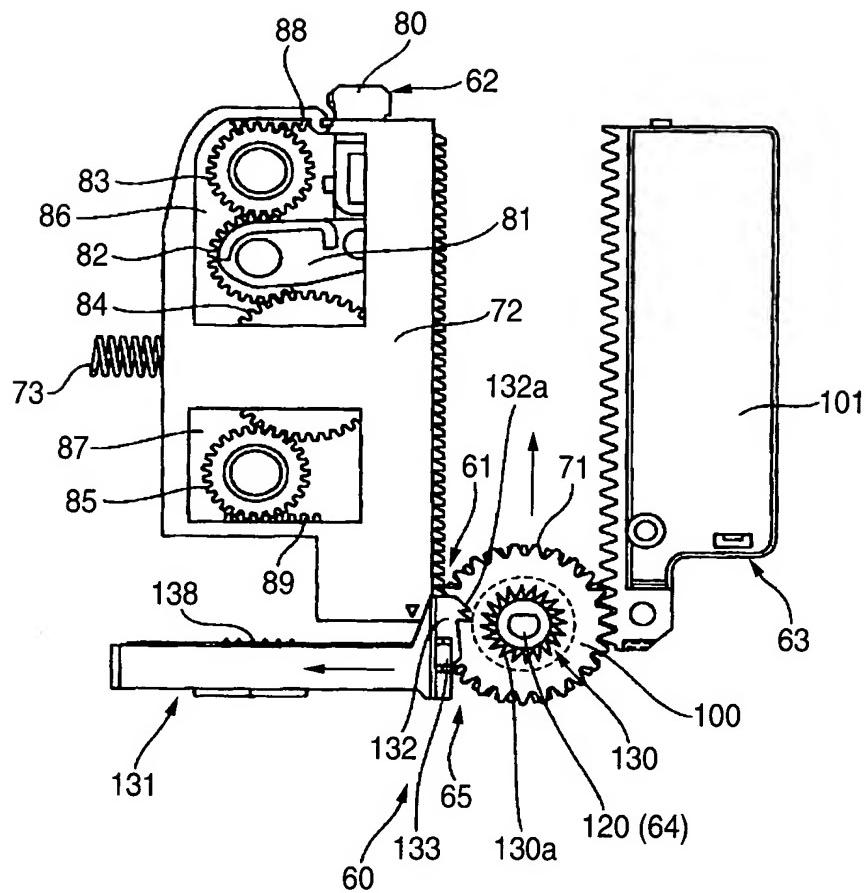

## **REPLACEMENT SHEET**

19/31

FIG. 19


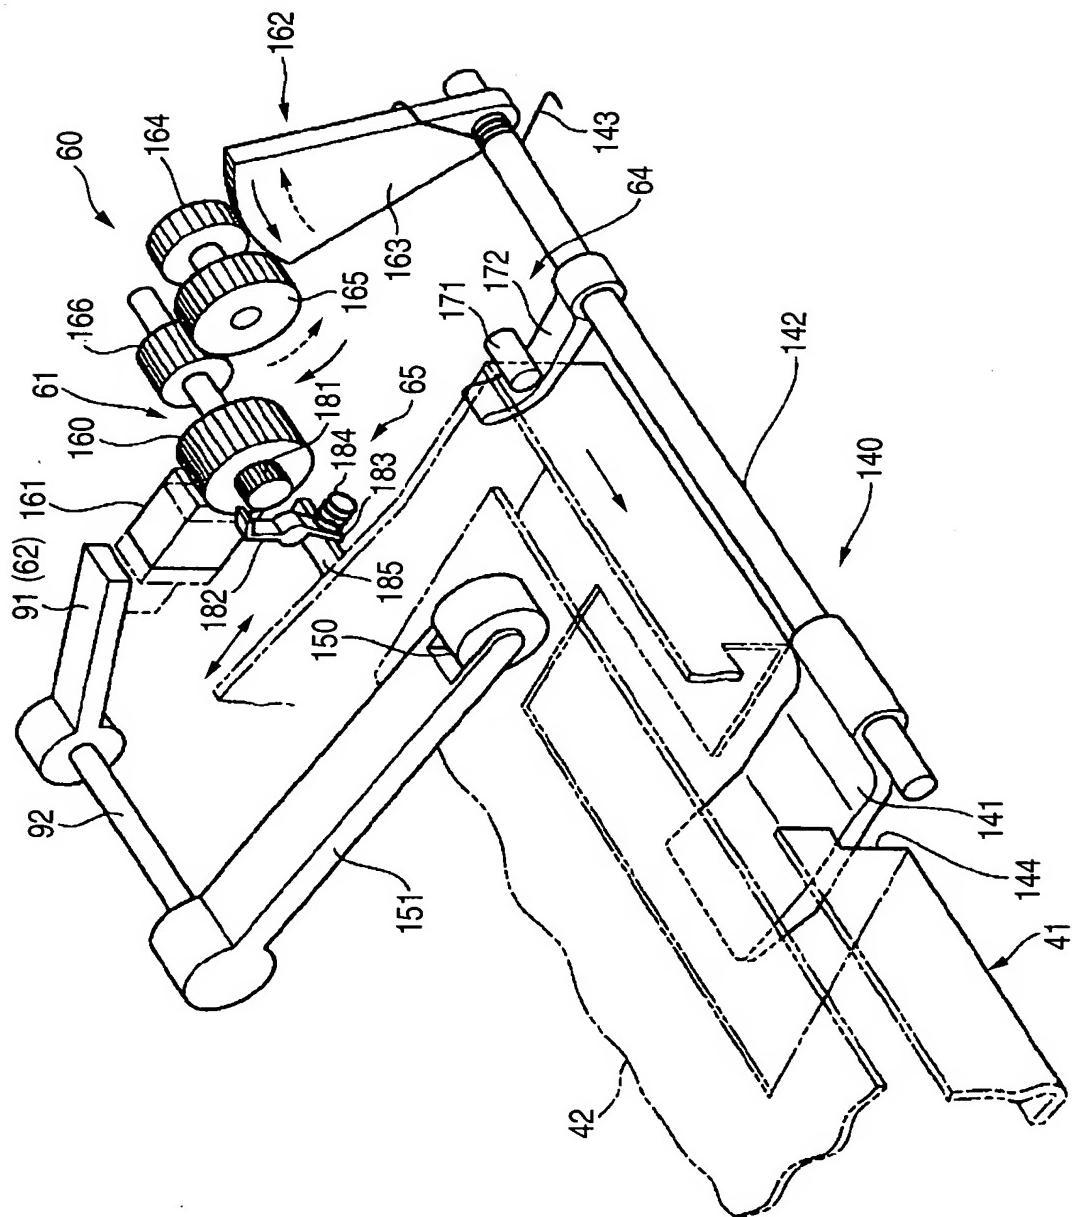



FIG. 20



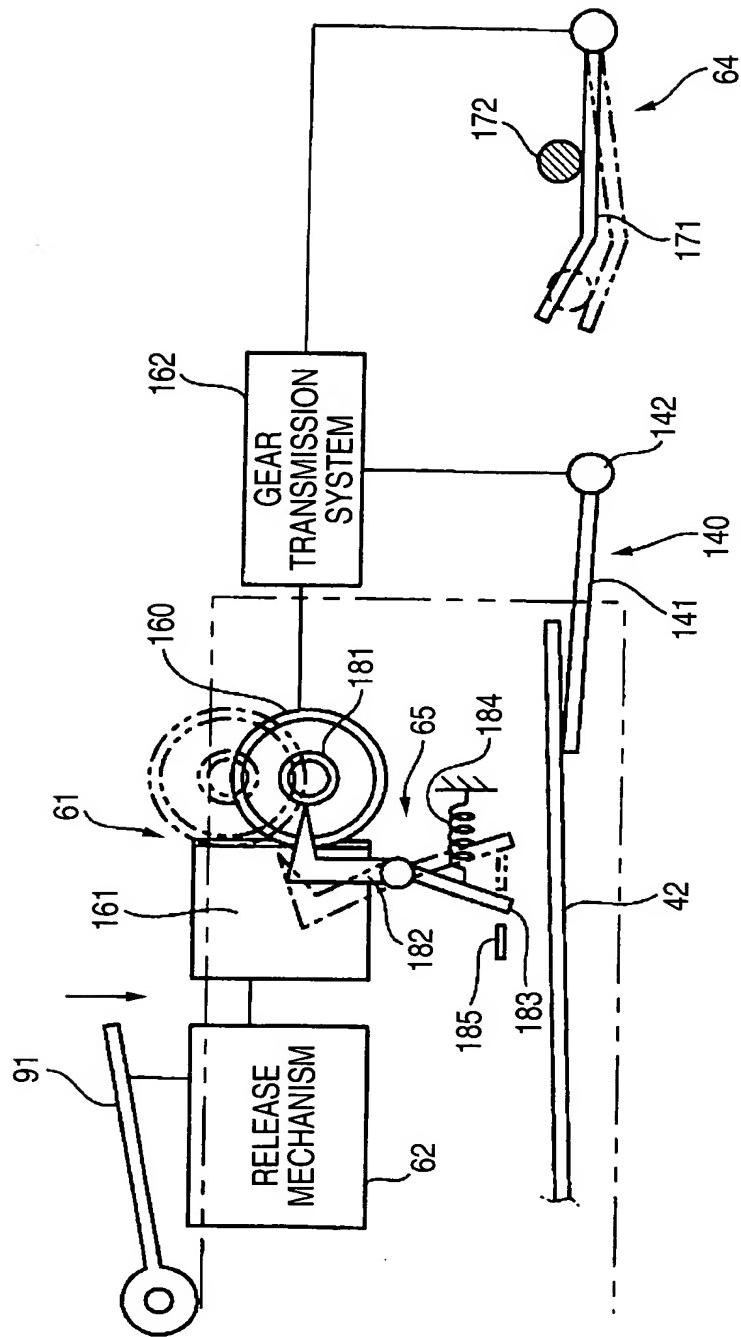

21/31


FIG. 21

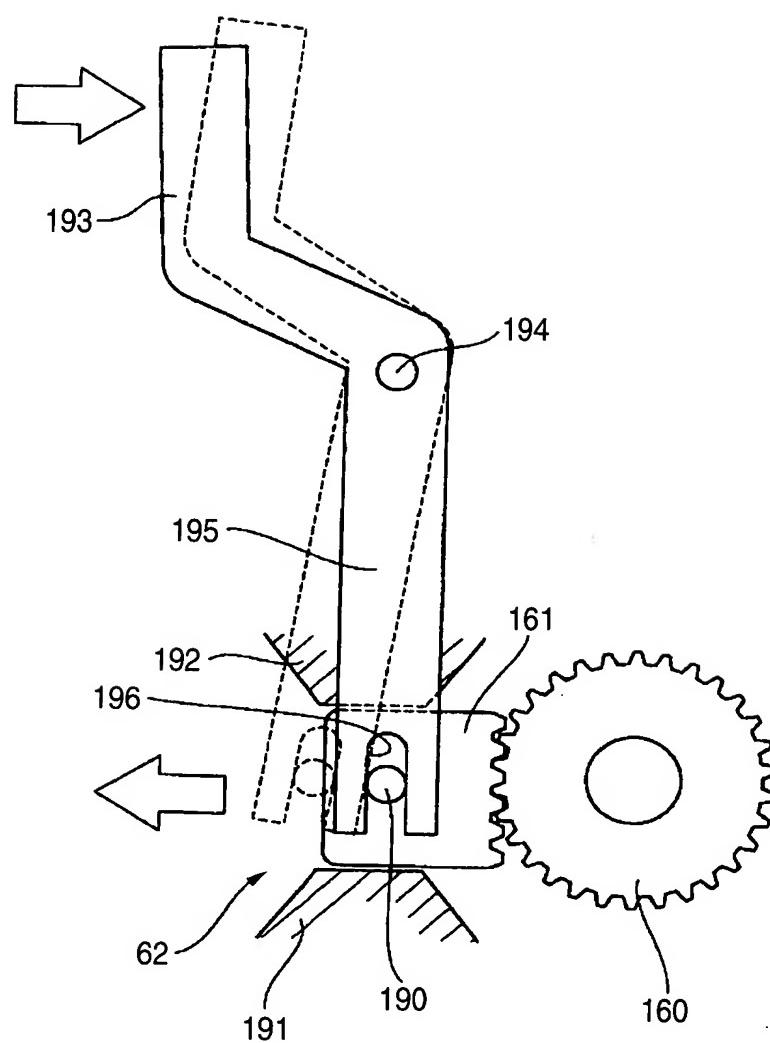

22/31



FIG. 22

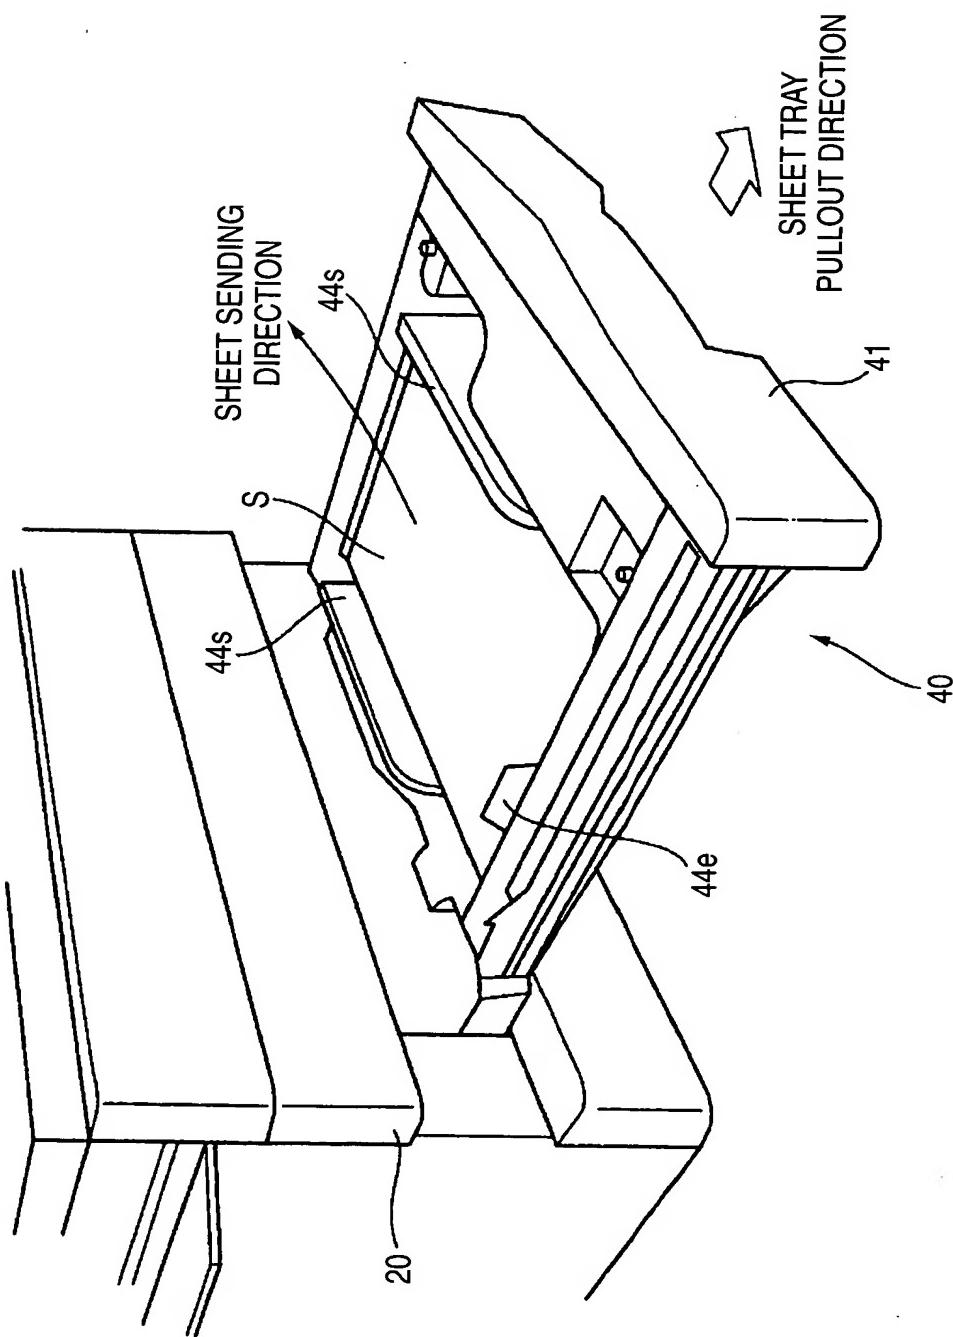





**REPLACEMENT  
SHEET**

23/31

FIG. 23

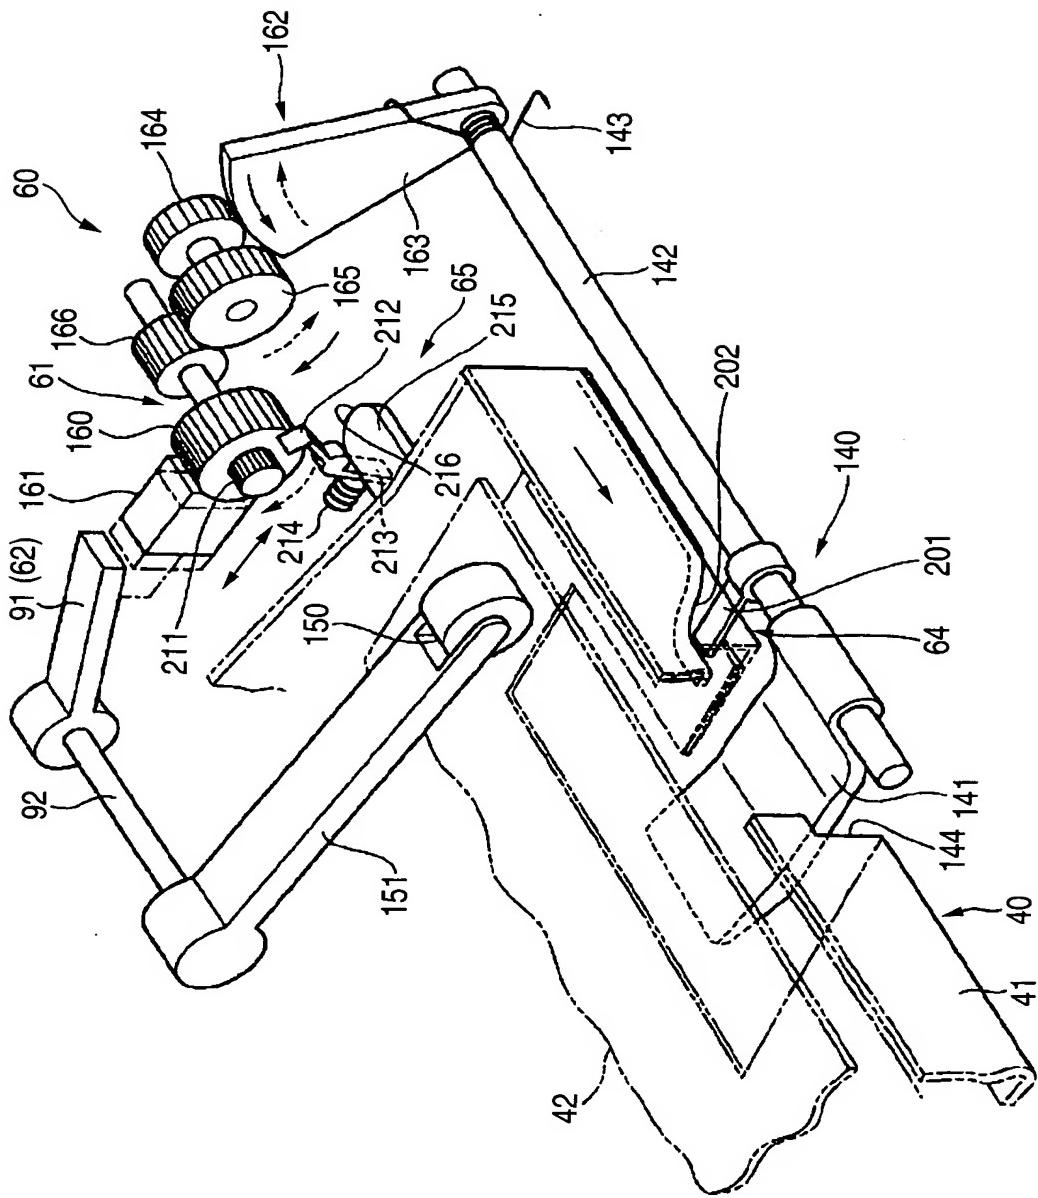

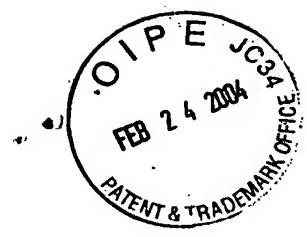

**REPLACEMENT  
SHEET**

24/31

FIG. 24


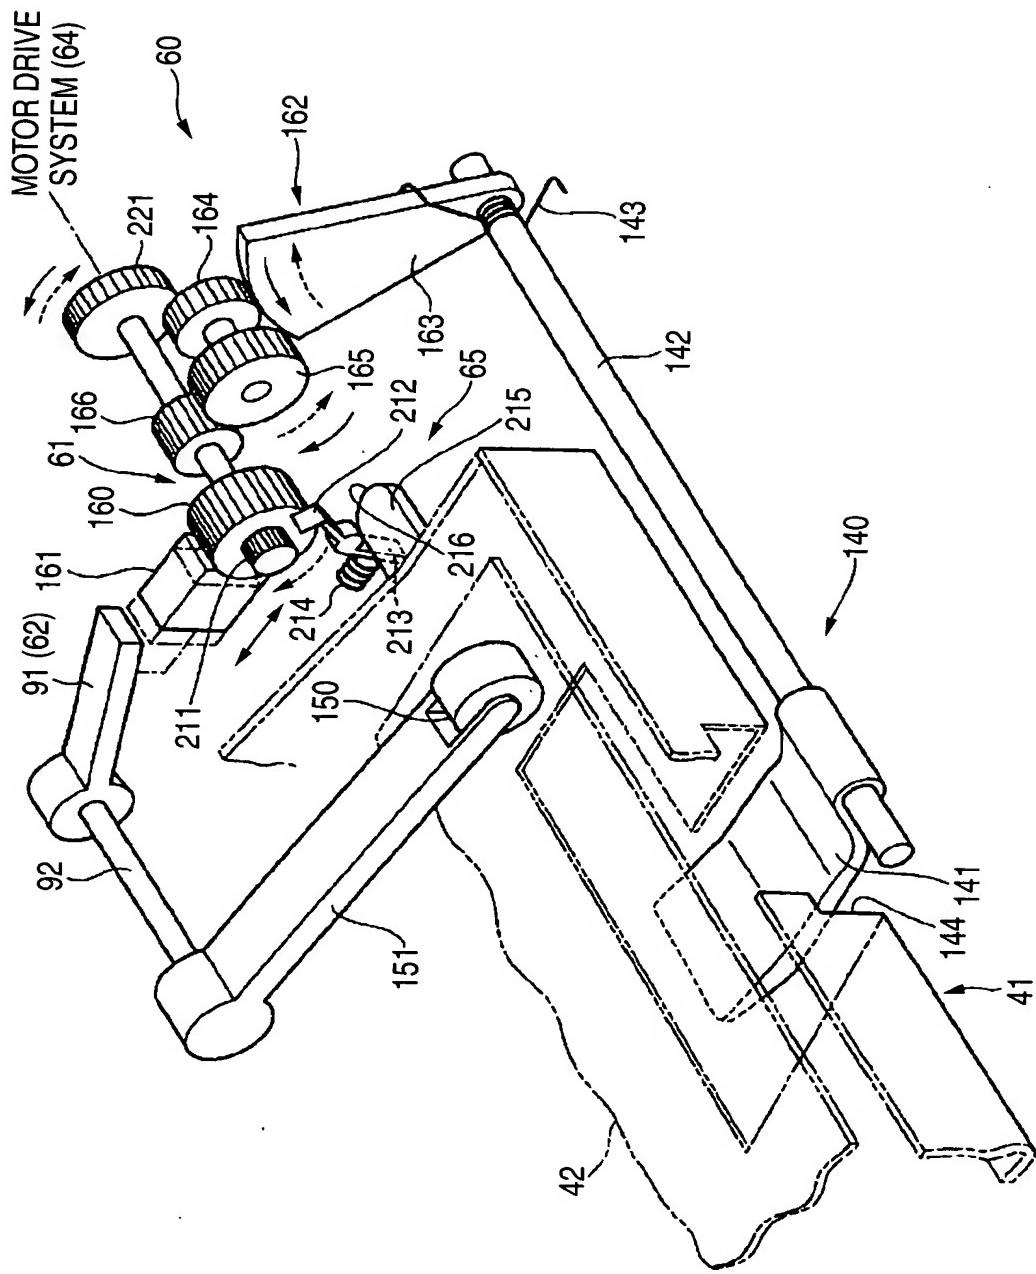




FIG. 25

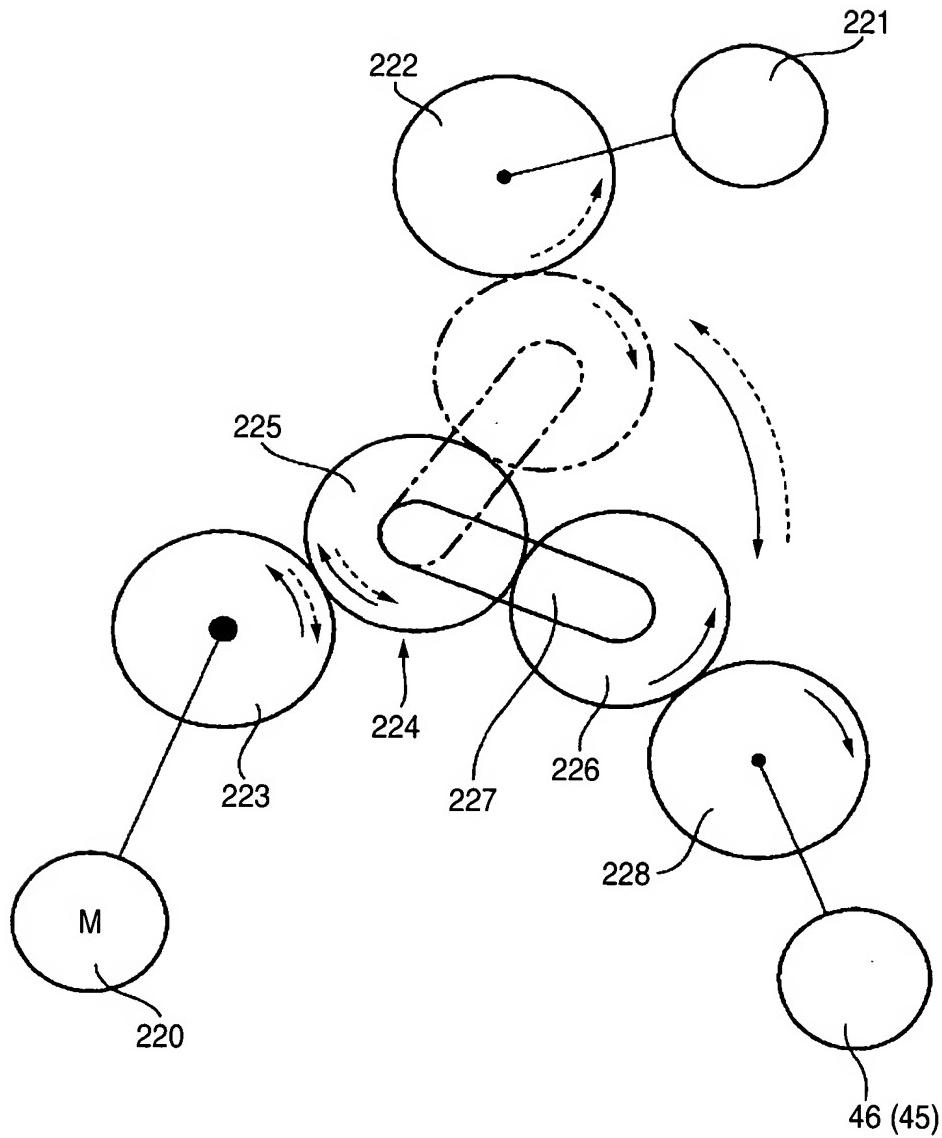

26/31



FIG. 26

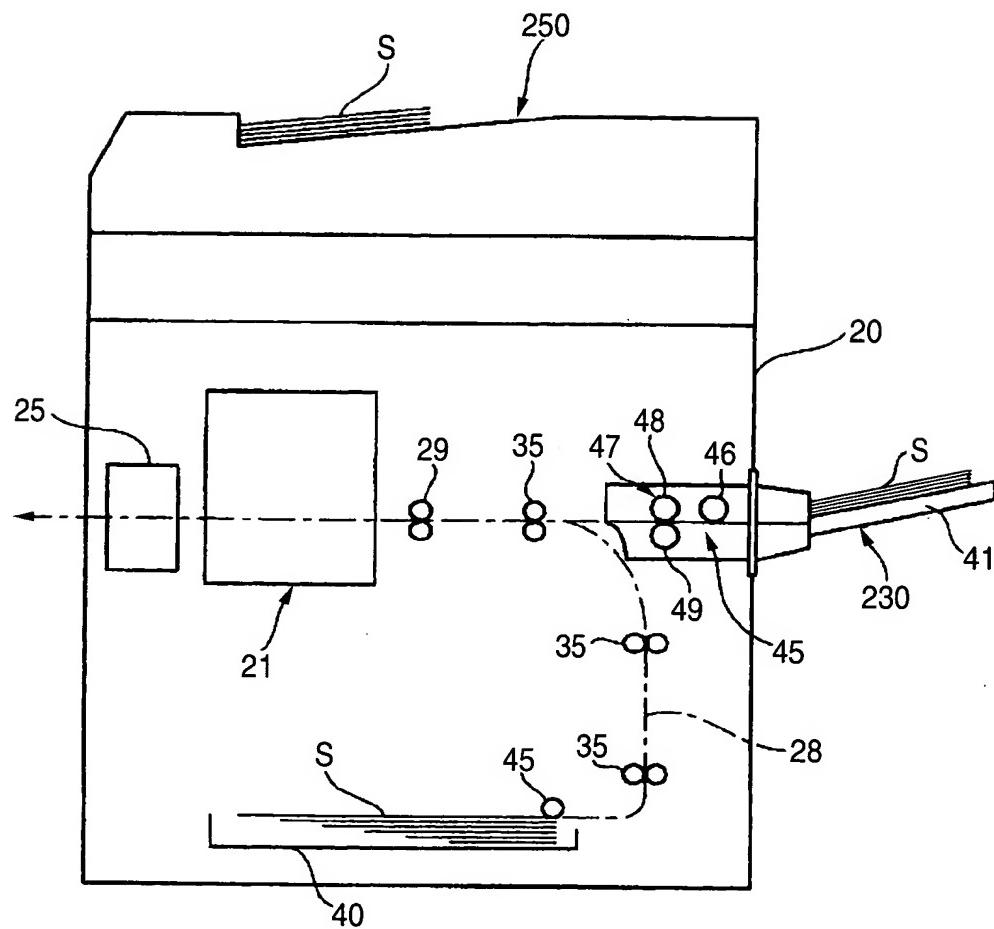




FIG. 27

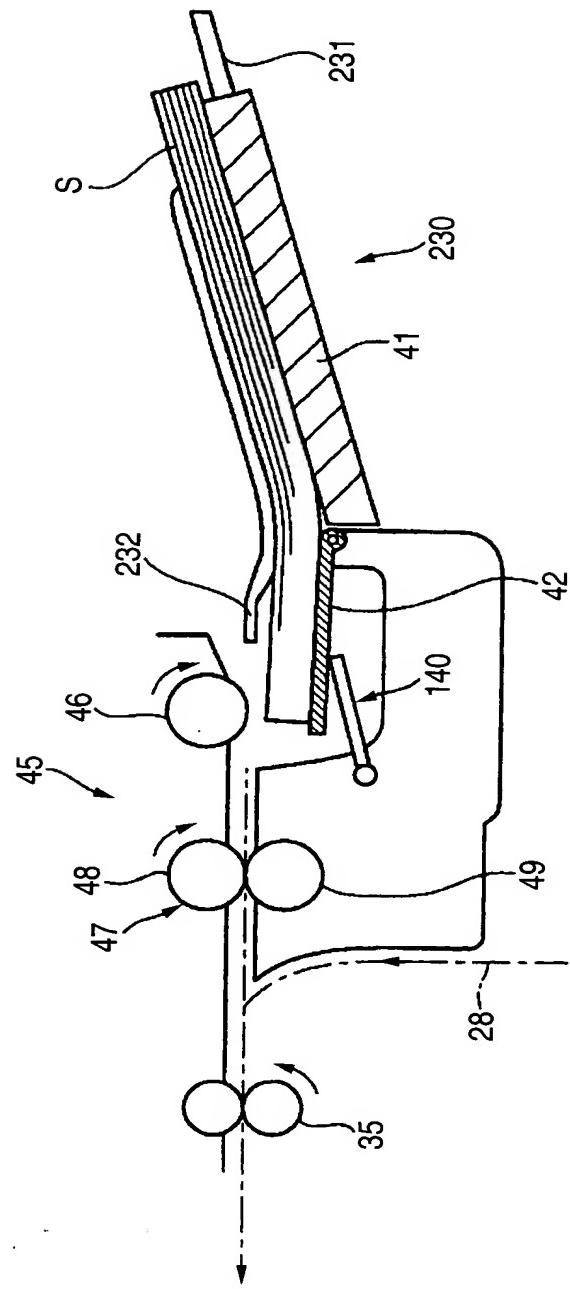


FIG. 28

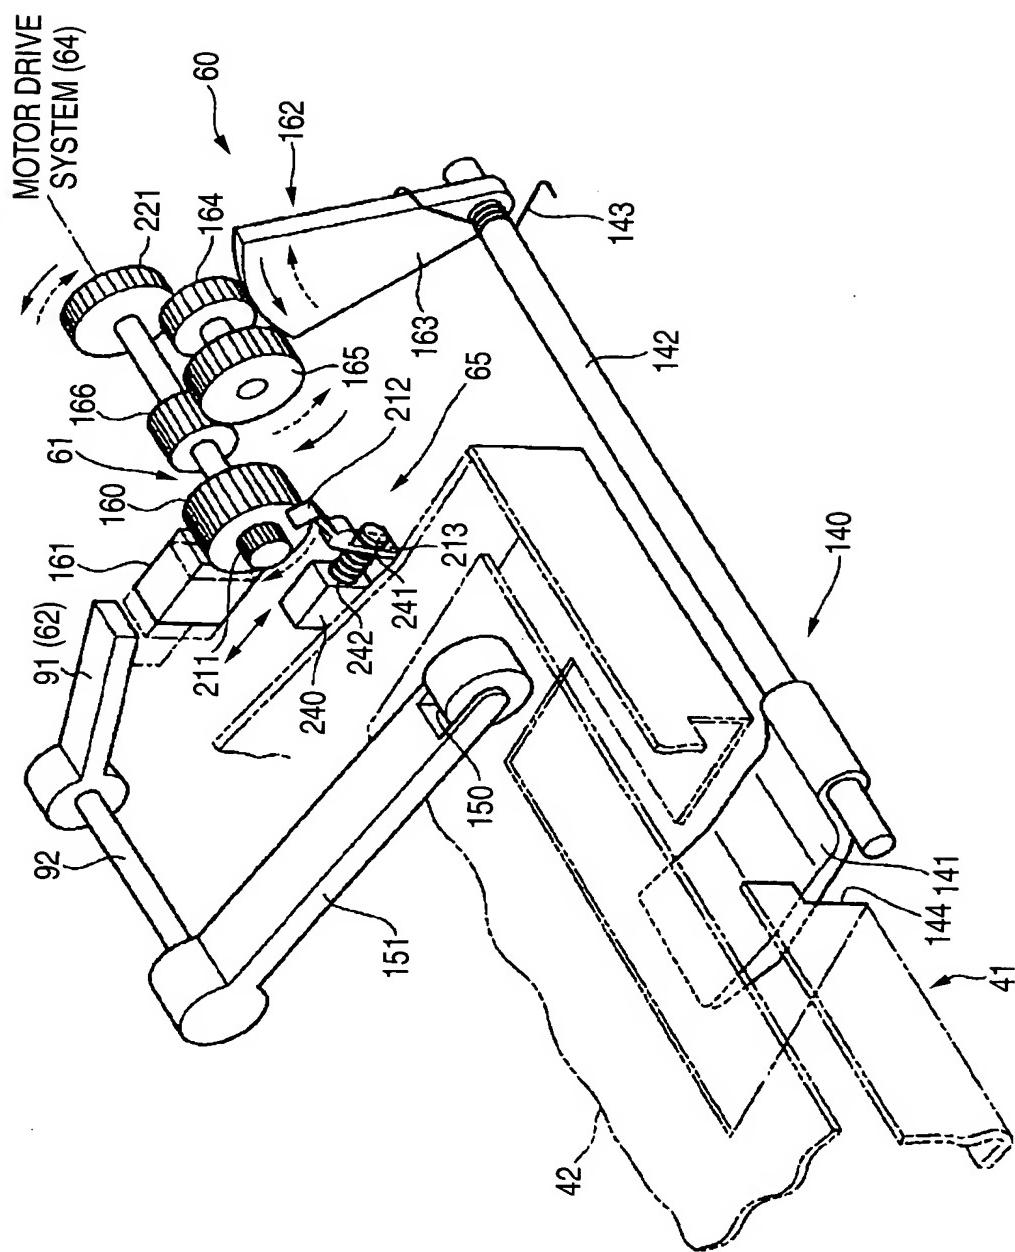




FIG. 29

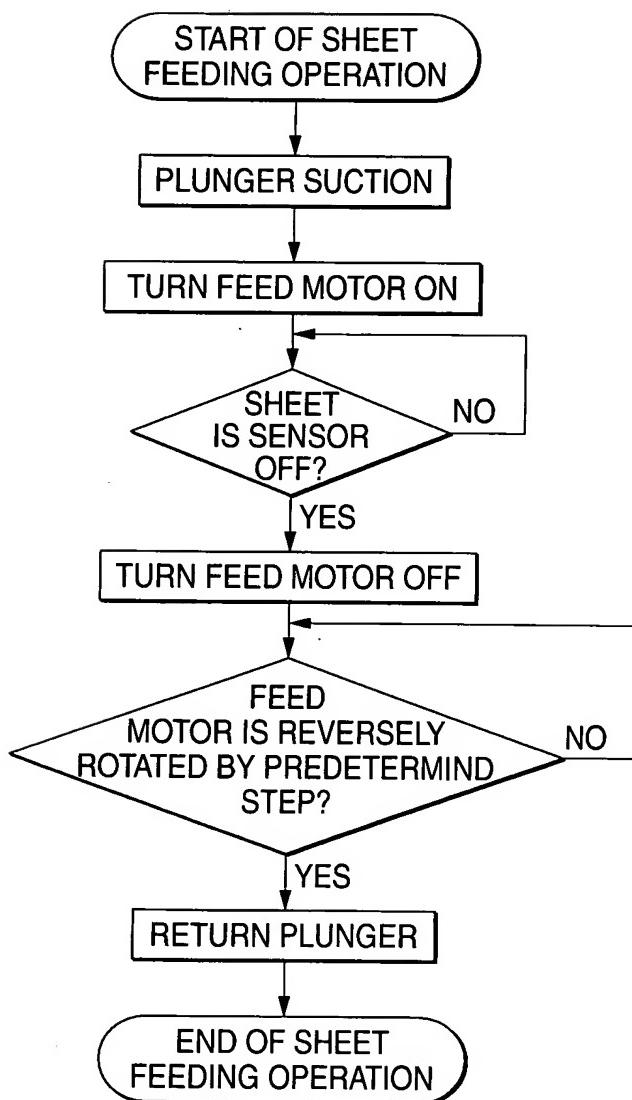


FIG. 30

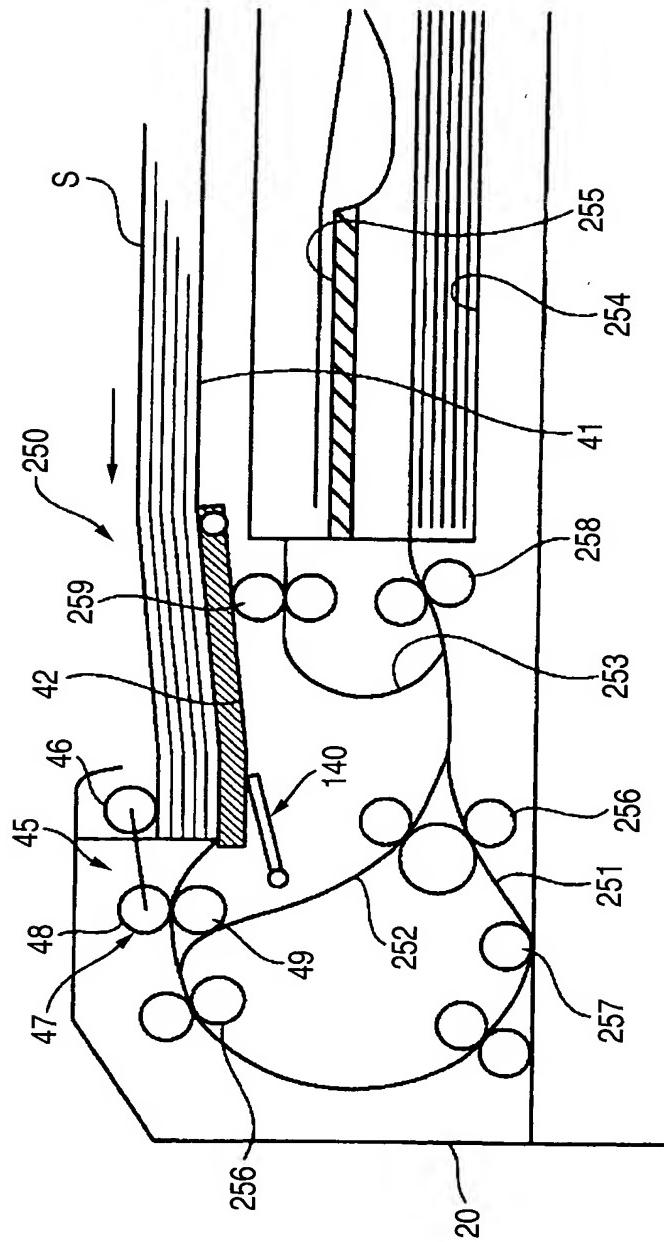




FIG. 31

